



BLEDEM-CP Constant-Power Emergency LED Driver






PROJECT: _____
 FIXTURE TYPE: _____
 LOCATION: _____
 CONTACT/PHONE: _____



DIMENSIONS

(Standard & -CEC models)

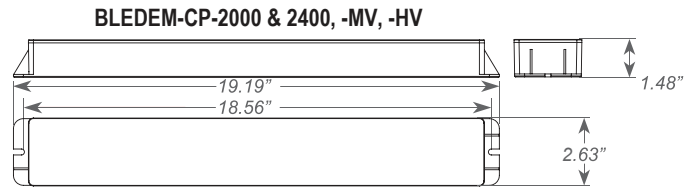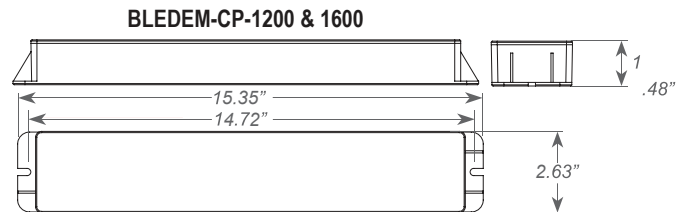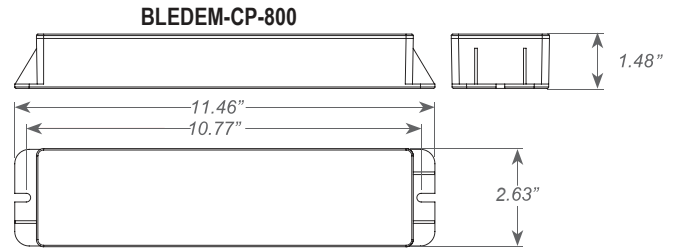

WARRANTY/LISTING

- UL Classified for factory or field installation
- Suitable for damp locations (0°C-50°C)
- 5 year warranty on all electronics and housing
- Meets UL924 NFPA 101 Life Safety Code, NEC, OSHA, Local and State codes.
- Optional - CEC models are Certified to CEC under Title 20 regulations.

ILLUMINATION

- Provides constant power output to the load during emergency mode operation
- Can be operated as NORMALLY-ON, NORMALLY-OFF or SWITCHED LOAD.

ELECTRICAL

- Universal 120-277V, 50/60 Hz input.
- Charge/Power "ON" LED Indicator light and push-to-test switch for mandated code compliance testing.
- Long-life, maintenance free, rechargeable NiCad battery.
- Output short/overcurrent protection: Electronic limiting, with normal operation resuming upon removal of fault.
- 90 Minute minimum emergency operating time over full temperature range (other run times available upon request).
- Output classification: Class 2 Compliant (excludes -MV/-HV models).
- Surge protection: Per C62.41 (TVS)
- Input overcurrent protection: Fusible link.
- 24 Hour maximum battery recharge time.

HOUSING

- LED illuminated and remote mounted test switch
- Injection-molded, engineering grade, 5VA flame retardant, high-impact resistant, thermoplastic in a black finish.

MOUNTING

- Suitable for installation inside, on top, or in remote mount of the fixture.

ORDERING INFORMATION

Lumen output based on LED light source having efficacy of 140-160 lumens/watt. Actual output may vary depending on light source utilized.

Provides regulated power from 5.0 watts to 17.0 watts (up to 800 to 2400 lumens)

MODEL	OUTPUT OPERATING RANGE		OUTPUT POWER	
	VOLTAGE (Vdc)	CURRENT (mAdc)	(Watts)	(Lumens)
BLEDEM-CP-800/ BLEDEM-CP-800-CEC	20-50	250-100	5.0	800
BLEDEM-CP-1200/ BLEDEM-CP-1200-CEC	20-50	390-156	7.8	1250
BLEDEM-CP-1600/ BLEDEM-CP-1600-CEC	20-50	535-214	10.7	1600
BLEDEM-CP-2000/ BLEDEM-CP-2000-CEC	20-50	685-274	13.7	2000
BLEDEM-CP-2400/ BLEDEM-CP-2400-CEC	20-50	850-340	17.0	2400
BLEDEM-CP-MV	50-110	340-154	17.0	2400
BLEDEM-CP-HV	100-220	170-77	17.0	2400





BLEDEM-CP Constant-Power Emergency LED Driver



PROJECT: _____
 FIXTURE TYPE: _____
 LOCATION: _____
 CONTACT/PHONE: _____

ELECTRICAL INFORMATION

MODEL	INPUT CURRENT (A)	INPUT POWER (W)
BLEDEM-CP-800/ BLEDEM-CP-800-CEC	0.061	3.9
BLEDEM-CP-1200/ BLEDEM-CP-1200-CEC	0.065	4.8
BLEDEM-CP-1600/ BLEDEM-CP-1600-CEC	0.087	5.7
BLEDEM-CP-2000/ BLEDEM-CP-2000-CEC	0.110	6.9
BLEDEM-CP-2400/ BLEDEM-CP-2400-CEC	0.110	7.9
BLEDEM-CP-MV	0.110	7.9
BLEDEM-CP-HV	0.110	7.9

BLEDEM-CP Series System Coordination Guidelines

These guidelines were developed to allow the lighting system Designer/Specifier to predict the operating performance levels of LED luminaires when powered by an electrically compatible BLEDEM-CP Series model. It is ultimately the responsibility of the Designer/Specifier to insure that the as installed system delivers code-compliant path of egress illumination.

1) Determine Electrical Compatibility

- A) Verify that the Luminaire LED Driver, where applicable, is Class 2 compliant (when using non-MV, non-HV models).
- B) Verify that the Luminaire LED Lamp(s) have an operating voltage that's in the 20Vdc–50Vdc or 50Vdc–110Vdc or 100Vdc–220Vdc range (depending on the BLEDEM-CP model being used).
- C) Verify that the Luminaire LED Lamp(s) have a power rating equal to, or greater than, the emergency power rating of the BLEDEM-CP model under consideration.

Please refer to Table 1.

2) Calculate Lumen Output During Emergency Operation

- A) Access luminaire data by logging onto Design Lites Consortium (www.designlights.org).
- B) Select "Search the DLC Qualified Product List" on the DLC homepage.
- C) Enter manufacturer name and P/N of luminaire under consideration in the "search by keyword" text window.
- D) Select "Search" tab to open the "Qualified Products List".
- E) Determine luminaire Lumens per Watt efficacy in "Rated Data" specifications.
- F) Multiply luminaire Lumens per Watt by Emergency Output of the BLEDEM-CP model under consideration.

Please refer to Table 1.

This figure is the Lumens available from the luminaire during emergency operation.

3) Determine Suitability of Means of Egress Lighting Levels

- A) Using industry standard lighting design software, along with IES files for the luminaire under consideration, verify that the as installed available Lumens (as calculated in 2F above) are sufficient to meet Code-compliant path of egress illumination levels.

While the BLEDEM-CP series has been found compliant with the requirements of UL Standard 924, it is ultimately the responsibility of the Designer/Specifier to assure the as-installed system delivers code-compliant path of egress illumination in accordance with Federal, State or local municipal requirements.

TABLE 1	
MODEL	OUTPUT POWER (constant)
BLEDEM-CP-800/ BLEDEM-CP-800-CEC	5.0 watts
BLEDEM-CP-1200/ BLEDEM-CP-1200-CEC	7.8 watts
BLEDEM-CP-1600/ BLEDEM-CP-1600-CEC	10.7 watts
BLEDEM-CP-2000/ BLEDEM-CP-2000-CEC	13.7 watts
BLEDEM-CP-2400/ BLEDEM-CP-2400-CEC	17.0 watts
BLEDEM-CP-MV	17.0 watts
BLEDEM-CP-HV	17.0 watts